



SERIOUS SERVICE®
Professional Machinery Health Care
(Fan Doctor®)

2017

Installation of CoolBlue Inductive Absorbers and Common Mode Current Measurement – Parc Riviera Pump Station



Contents

	Page
Overview	3
Equipment Information	5
Test Procedure	6
Test Results	7
Summary	22

Overview

Problems with IGBT Systems


VFD systems are not sinusoidal but are a continuous generation of pulses (Pulse Width Modulation or PWM). The pulses have a constant voltage and a dv/dt rise and fall time of the pulse. The original VFD systems were based on Bipolar Junction Transistors. The trend now is toward IGBT (Insulated Gate Bipolar Transistor from Mitsubishi, On Semi, Infineon, ST Micro, etc.) systems which give a faster switching dv/dt with lower switching losses and a more efficient drive.

IGBT systems create problems associated with the system performance. The IGBT introduces parasitic currents in the form of two potential destructive characteristics:

- a) Transient Voltage/ Harmonic Distortion/Reflective Waves
- b) Higher magnitudes of electrical ground noise current


Electrical Discharge Machining

AC Motor Drive systems utilizing variable frequency controls produce high frequency electrical noise. The noise is superimposed on the power drive lines of the motors in the form of common mode noise. The common mode noise creates a voltage (dv/dt) across the rotor/stator of the motor resulting in a discharge current through the lubrication and motor bearings to the motor raceway.

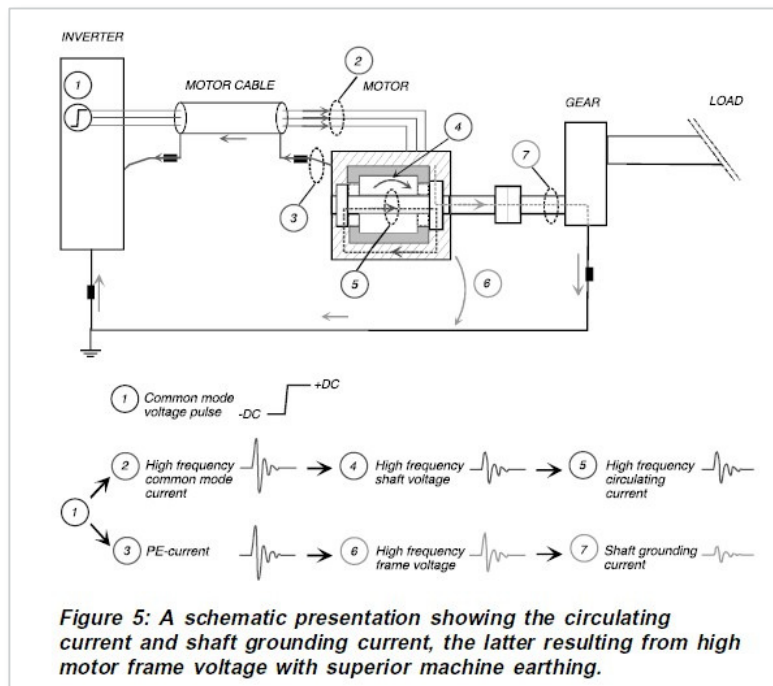

This current discharge produces an EDM effect (Electrical Discharge Machining) that causes destructive pitting and damage to the motor raceway, and premature lubrication breakdown. The end result is premature failure of the motor causing expensive repairs and system downtime.

Overview

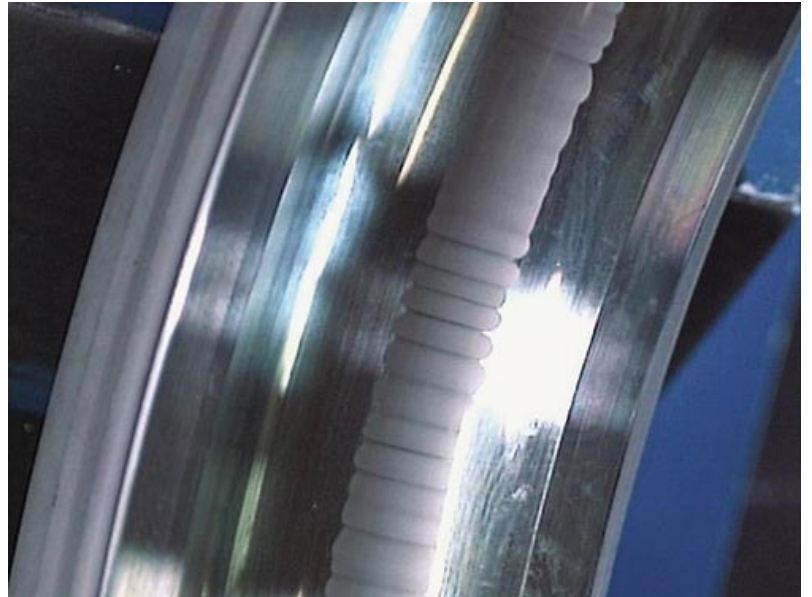


Typical bearing fluting caused by EDM

Problems with IGBT Systems


Each pulse in a PWM system is not a clean square pulse. Each Rise and Fall of the pulse has an over shoot or transient over-voltage. This over-voltage phenomenon is also known as "Reflected Wave", "Transmission Line Effect" or "Standing Wave".

The per unit overvoltage magnitude is dependent upon drive-cable-motor circuit dynamics defined by drive output voltage magnitude and rise time, cable surge impedance characteristics, motor surge impedance to the pulse voltage, cable length and spacing of the train of pulses by the PWM modulator.

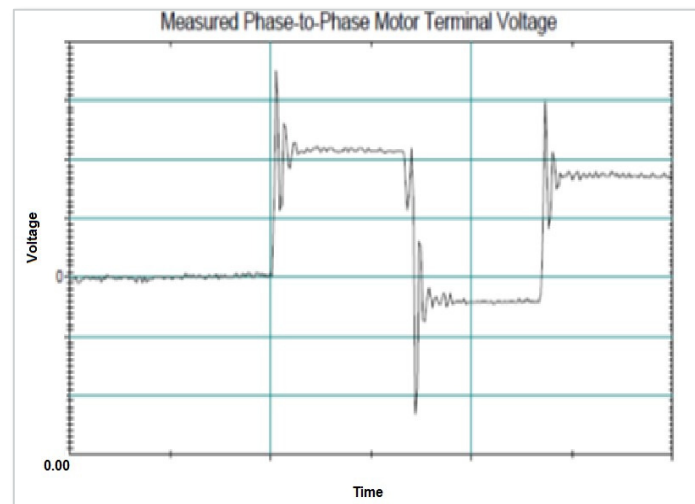


Equipment Information


Pump #1

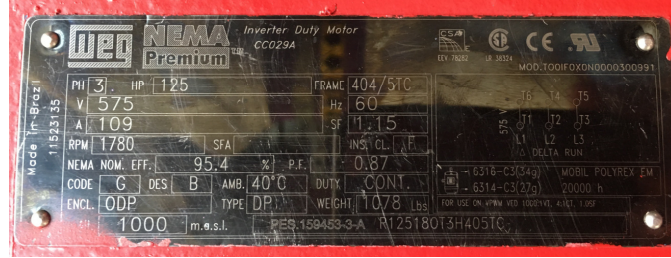

Pump #2

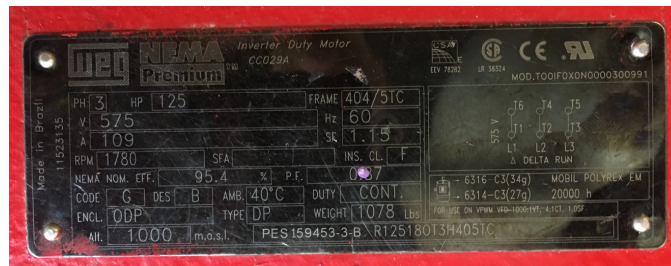

Pump #3

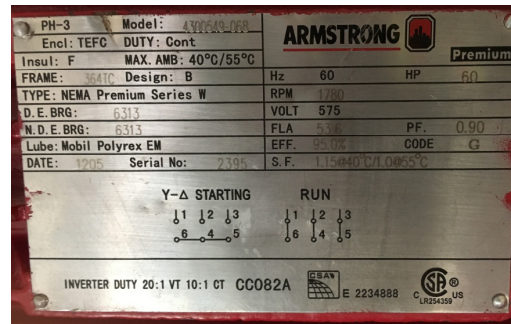

Pump #4



Test Procedure

The simplest and safest way to measure common mode current is with a flexible, clip-around, Rogowski coil. This method is used to measure high frequency destructive common mode currents in motor drives . . . high frequencies produced by motor drive IGBT's in the kHz up to several MHz's.

The high frequency Rogowski coil simply connects around the 3 power phases of cable going from the drive to the motor to measure common mode current. If multiple cables per phase, coil would still go around all cables. The output of the Rogowski coil connects to the DCM 100, and measures the common mode current.

Simply power down, place the Rogowski coil around 3 phases of power.

Power up system. Measure current.



Test Results

DCM Project Report

Vibes Corp - Parc Riviera: Pump #1

Motor Power: 125.0hp

Created: Nov 10, 2017 9:42 AM

Cable Length: 30ft

Modified: Nov 10, 2017 10:33 AM

Project Notes:

Recommended Solution

CoolBLUE® Inductive Absorbers (all lines): 4 x M-302 -or- 4 x M-116

NaLA® Line Absorbers (per line): 1 x M-613

In applications where high reliability is needed the use of NaLA® differential mode line absorber is recommended.

Recorded Data

<u>Date Recorded</u>	<u>Peak Spike</u>	<u>Reduction</u>	<u>Avg Spike</u>	<u>Reduction</u>
Nov 10, 2017 10:27 AM	17.92 Amps	BASELINE	3.91 Amps	BASELINE
Nov 10, 2017 10:33 AM	5.07 Amps	-72%	1.86 Amps	-52%



BASELINE DATA


Peak Current Spike: 17.92 Amps

Recorded: Nov 10, 2017 10:27 AM

Average Current Spike: 3.91 Amps

Time/Div: 5 μs

Notes: CoolBlue Defeated

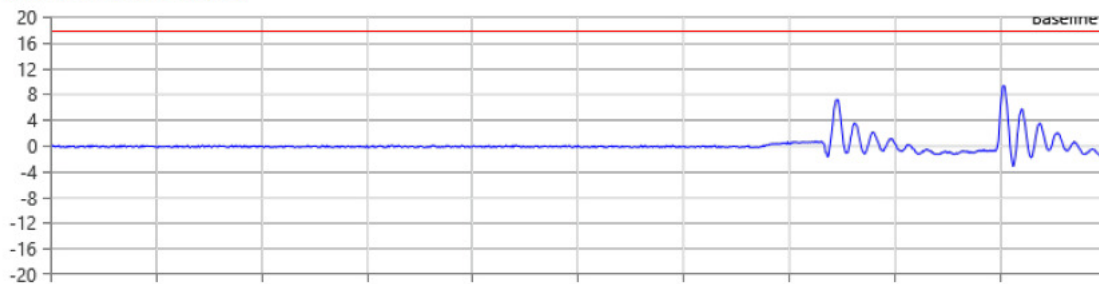

Test Results

DCM Project Report

Vibes Corp - Parc Riviera: Pump #1


Peak Current Spike: 5.07 Amps (-72%)

Recorded: Nov 10, 2017 10:33 AM


Average Current Spike: 1.86 Amps (-52%)

Time/Div: 5 μ s


Notes: CoolBlue Installed

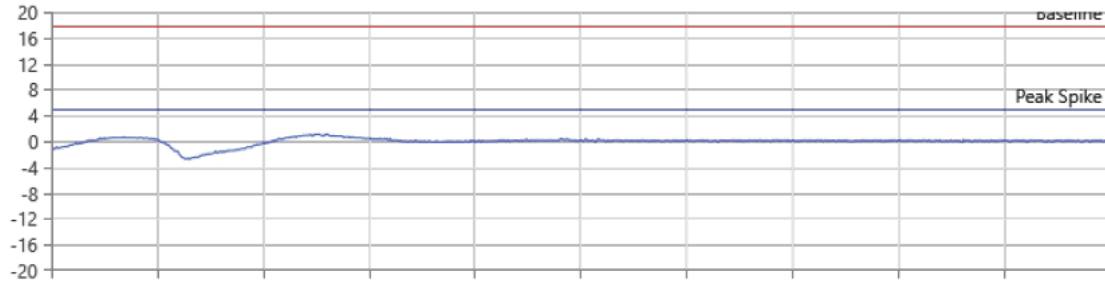

Test Results

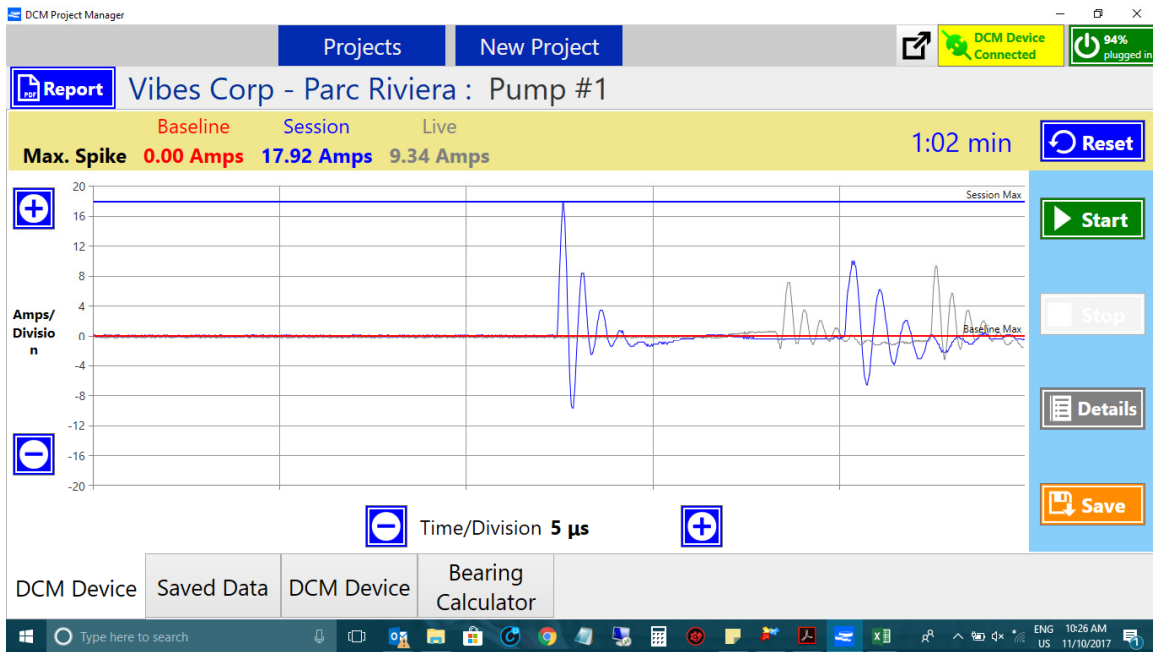

Baseline Snapshot

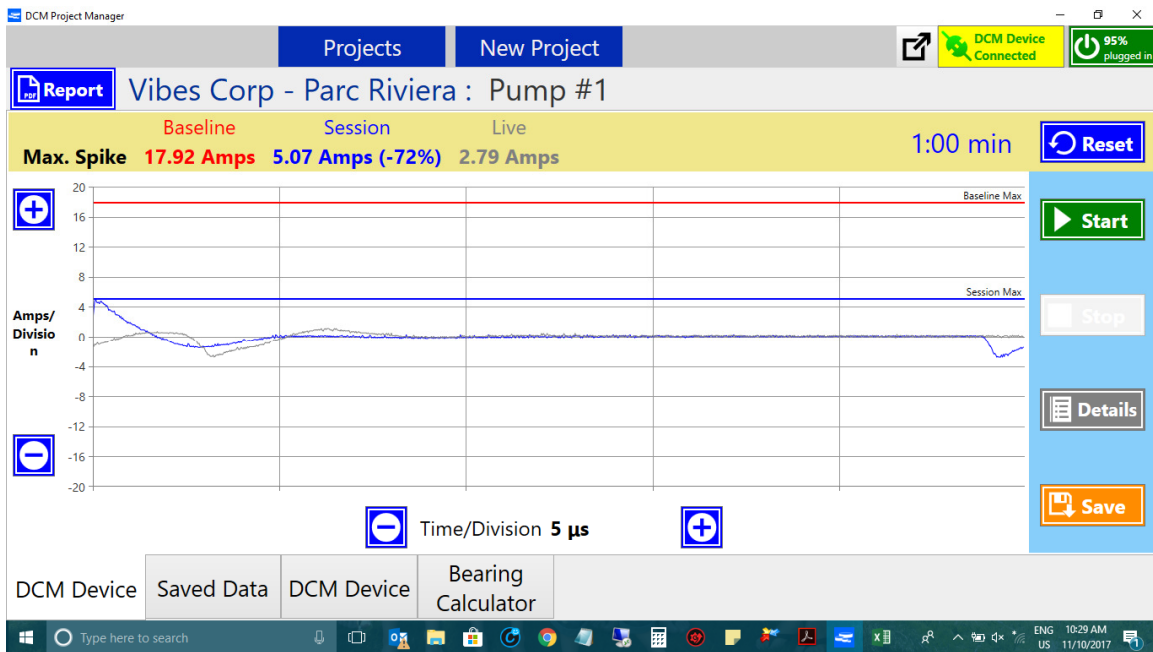

Snapshot After CoolBlue® Installation

Test Results

DCM Project Report

Vibes Corp - Parc Riviera: Pump #2

Motor Power: 125.0hp

Created: Nov 10, 2017 9:02 AM

Cable Length: 30ft

Modified: Nov 10, 2017 10:38 AM

Project Notes:

Recommended Solution


CoolBLUE® Inductive Absorbers (all lines): 4 x M-302 -or- 4 x M-116

NaLA® Line Absorbers (per line): 1 x M-613

In applications where high reliability is needed the use of NaLA® differential mode line absorber is recommended.

Recorded Data

<u>Date Recorded</u>	<u>Peak Spike</u>	<u>Reduction</u>	<u>Avg Spike</u>	<u>Reduction</u>
Nov 10, 2017 10:36 AM	19.62 Amps	BASELINE	4.19 Amps	BASELINE
Nov 10, 2017 10:38 AM	5.34 Amps	-73%	2.03 Amps	-51%

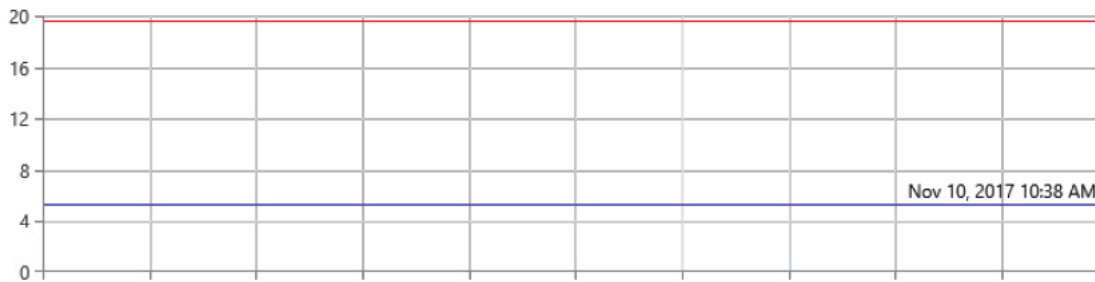

BASELINE DATA

Peak Current Spike: 19.62 Amps

Recorded: Nov 10, 2017 10:36 AM

Average Current Spike: 4.19 Amps

Time/Div: 5 μs

Notes: CoolBlue Defeated



Test Results

DCM Project Report

Vibes Corp - Parc Riviera: *Pump #2*


Peak Current Spike: 5.34 Amps (-73%)

Recorded: Nov 10, 2017 10:38 AM


Average Current Spike: 2.03 Amps (-51%)

Time/Div: 5 μ s


Notes: *CoolBlue Installed*

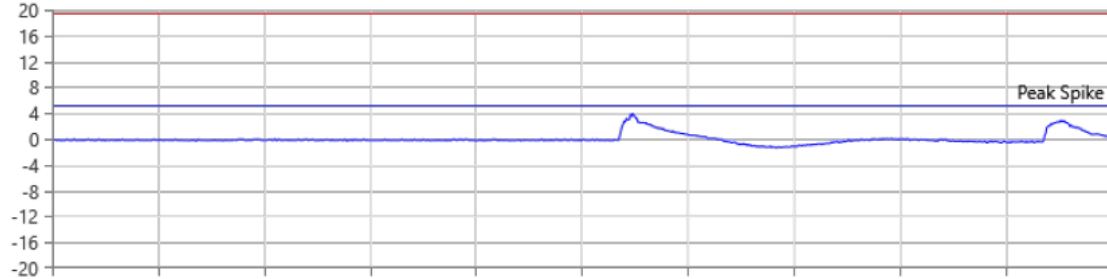

Test Results

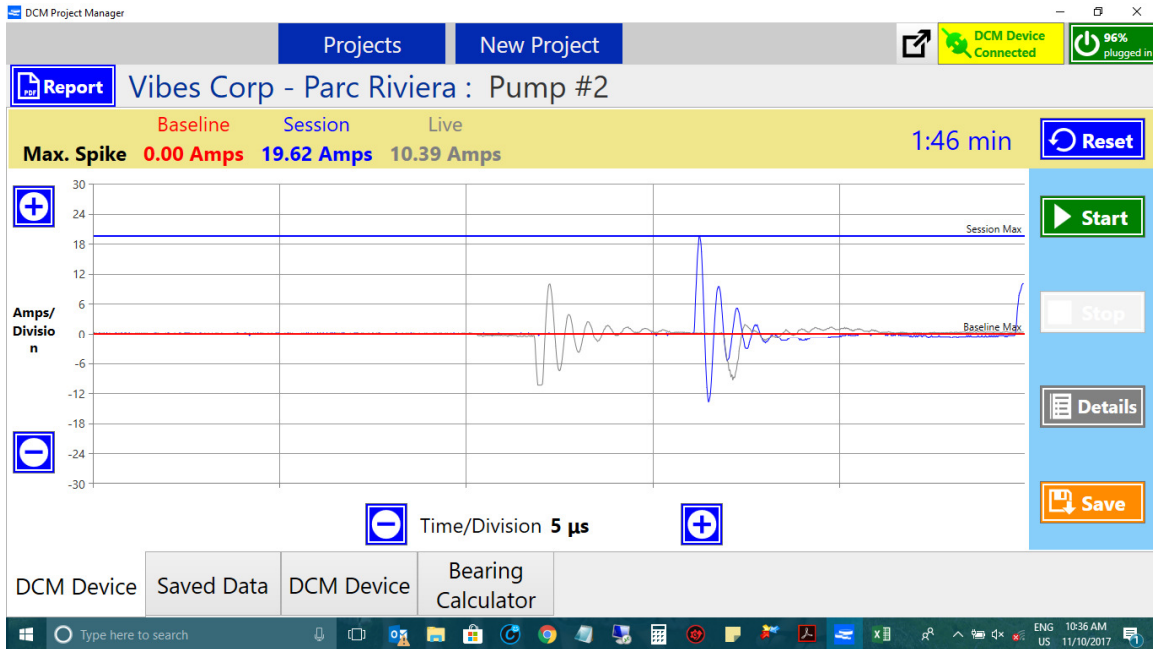

Baseline Snapshot

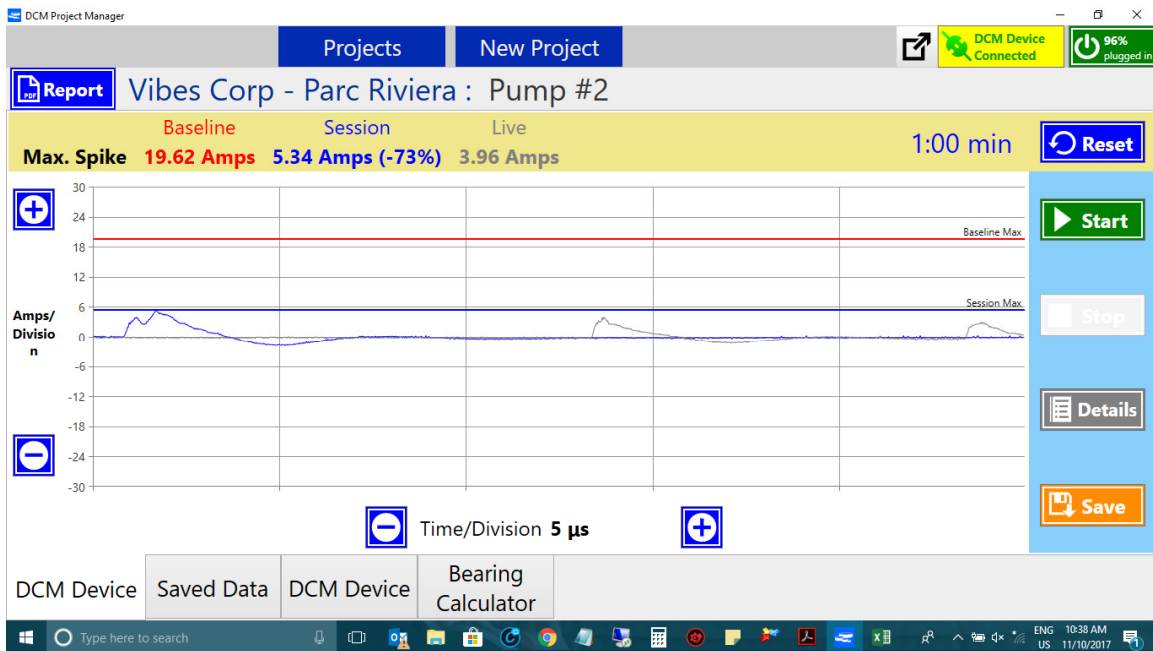

Snapshot After CoolBlue® Installation

Test Results

DCM Project Report

Vibes Corp - Parc Riviera: *Pump #3*

Motor Power: 60.0hp

Created: Nov 10, 2017 9:17 AM

Cable Length: 30ft

Modified: Nov 10, 2017 10:48 AM

Project Notes:

Recommended Solution


CoolBLUE® Inductive Absorbers (all lines): 4 x M-283 -or- 4 x N/A

NaLA® Line Absorbers (per line): 1 x M-381

In applications where high reliability is needed the use of NaLA® differential mode line absorber is recommended.

Recorded Data

Date Recorded	Peak Spike	Reduction	Avg Spike	Reduction
Nov 10, 2017 10:46 AM	12.57 Amps	BASELINE	2.60 Amps	BASELINE
Nov 10, 2017 10:48 AM	5.20 Amps	-59%	1.29 Amps	-50%

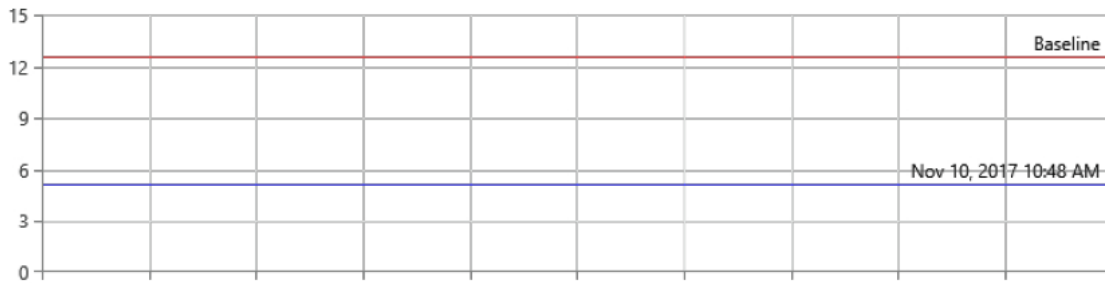

BASELINE DATA

Peak Current Spike: 12.57 Amps

Recorded: Nov 10, 2017 10:46 AM

Average Current Spike: 2.60 Amps

Time/Div: 5 μ s

Notes: CoolBlue Defeated



Test Results

DCM Project Report

Vibes Corp - Parc Riviera: Pump #3


Peak Current Spike: 5.20 Amps (-59%)

Recorded: Nov 10, 2017 10:48 AM


Average Current Spike: 1.29 Amps (-50%)

Time/Div: 5 μ s


Notes: CoolBlue Installed

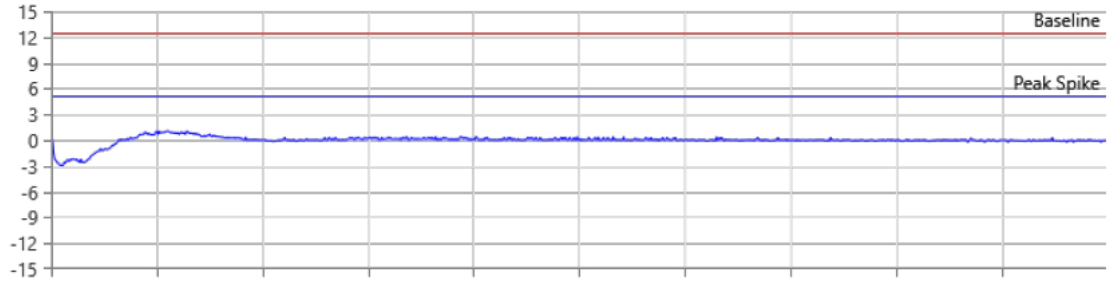

Test Results

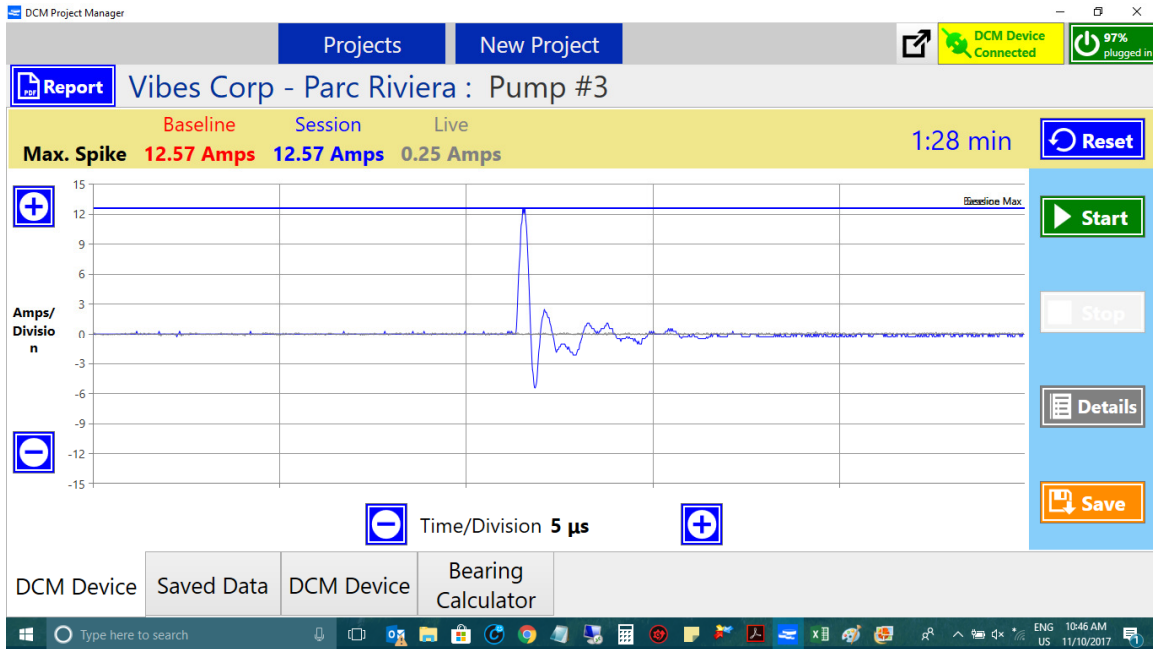

Baseline Snapshot

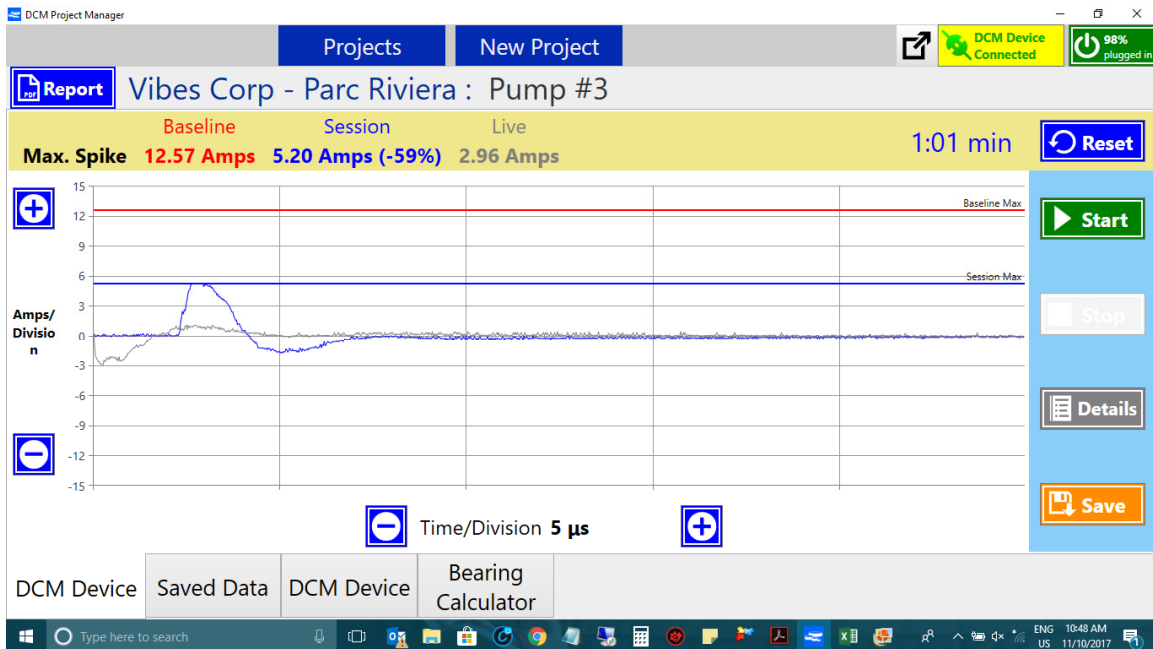

Snapshot After CoolBlue® Installation

Test Results

DCM Project Report

Vibes Corp - Parc Riviera: *Pump #4*

Motor Power: 60.0hp

Created: Nov 10, 2017 9:41 AM

Cable Length: 30ft

Modified: Nov 10, 2017 11:03 AM

Project Notes:

Recommended Solution

CoolBLUE® Inductive Absorbers (all lines): 4 x M-283 -or- 4 x N/A

NaLA® Line Absorbers (per line): 1 x M-381

In applications where high reliability is needed the use of NaLA® differential mode line absorber is recommended.

Recorded Data

Date Recorded	Peak Spike	Reduction	Avg Spike	Reduction
Nov 10, 2017 11:01 AM	12.53 Amps	BASELINE	5.05 Amps	BASELINE
Nov 10, 2017 11:03 AM	4.59 Amps	-63%	1.87 Amps	-63%



BASELINE DATA


Peak Current Spike: 12.53 Amps

Recorded: Nov 10, 2017 11:01 AM

Average Current Spike: 5.05 Amps

Time/Div: 5 μs

Notes: CoolBlue Defeated

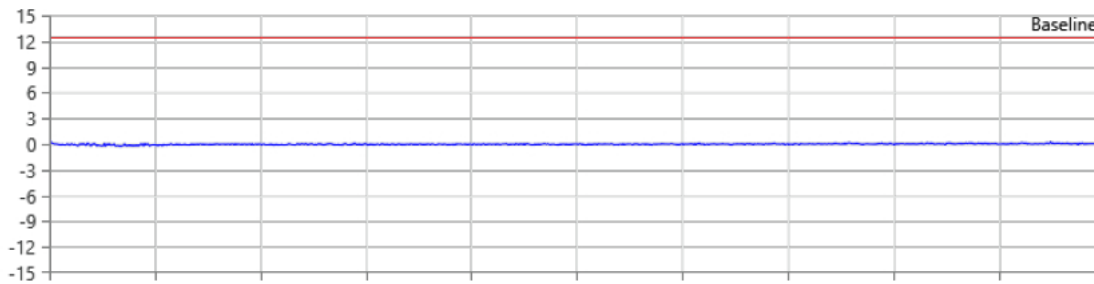

Test Results

DCM Project Report

Vibes Corp - Parc Riviera: *Pump #4*


Peak Current Spike: 4.59 Amps (-63%)

Recorded: Nov 10, 2017 11:03 AM


Average Current Spike: 1.87 Amps (-63%)

Time/Div: 5 μ s


Notes: *CoolBlue Installed*

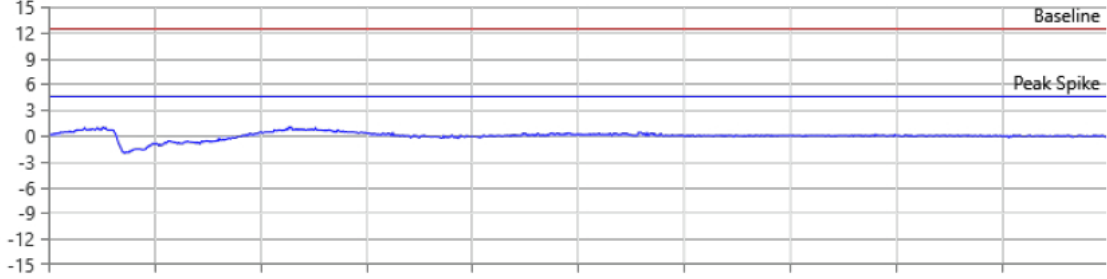

Test Results

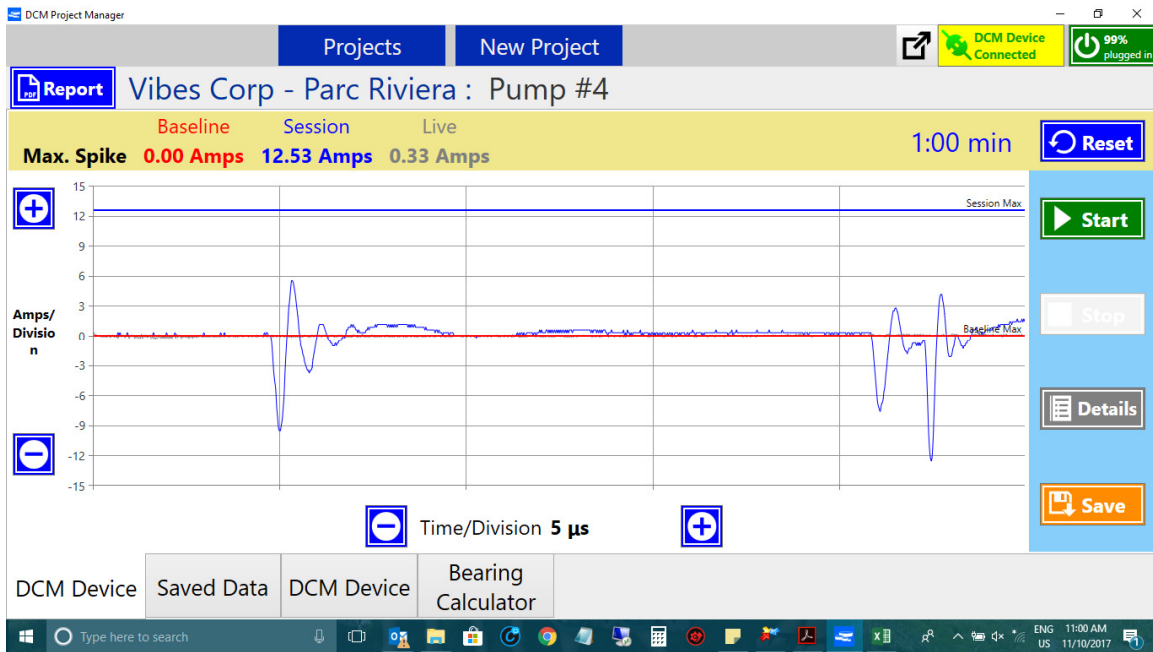

Baseline Snapshot

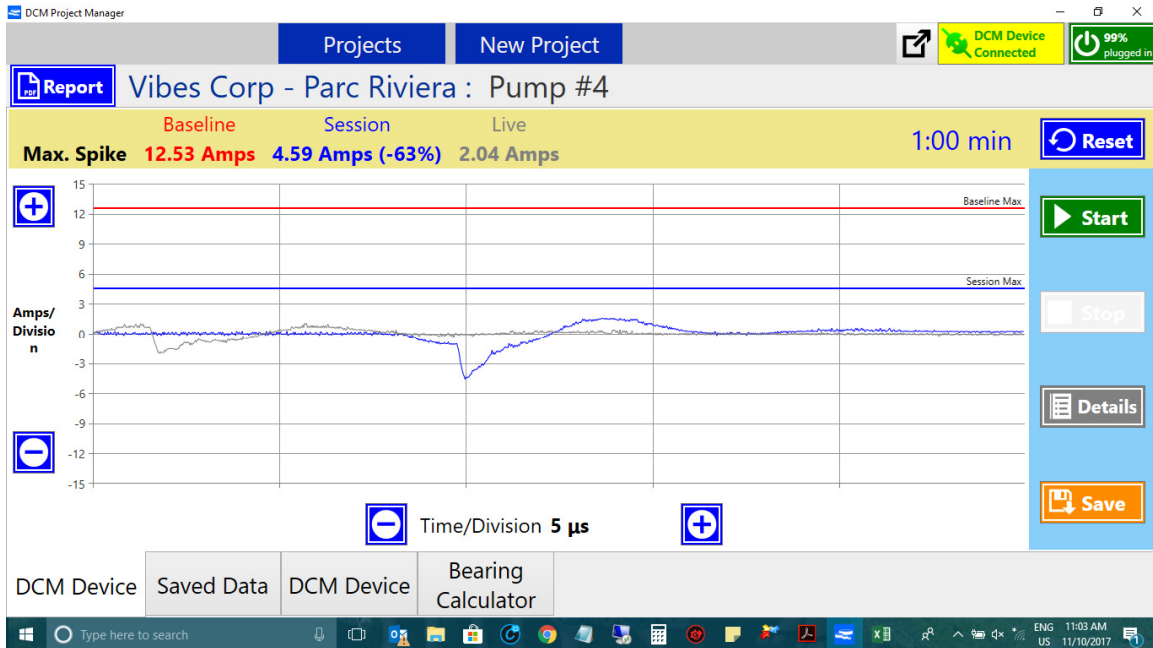

Snapshot After CoolBlue® Installation

Test Results

It is recommended that common mode currents are kept down to a level so that the current density in the bearing is below 0.2 Amps per mm² of ball to race contact surface area.

As displayed by our EDM bearing calculator below, the common mode current peaks measured after the CoolBlue's[®] were installed are now at a safe level for the bearings in these motors.

Pump #1 Before CoolBlue[®]



EDM BEARING CALCULATOR

SERIOUS SERVICE[®]
 Professional Machinery Health Care
 (Fan Doctor[®])

Bearing Number	6316	
Ball Diameter (mm)	28.58	
Peak Current (A)	17.92	
Current Density (A/mm ²)	0.2	Fail*
Maximum Allowable Current (A)	13.46	



EDM BEARING CALCULATOR

SERIOUS SERVICE[®]
 Professional Machinery Health Care
 (Fan Doctor[®])

Bearing Number	6314	
Ball Diameter (mm)	25.40	
Peak Current (A)	17.92	
Current Density (A/mm ²)	0.2	Fail*
Maximum Allowable Current (A)	11.96	

Pump #1 After CoolBlue[®]



EDM BEARING CALCULATOR

SERIOUS SERVICE[®]
 Professional Machinery Health Care
 (Fan Doctor[®])

Bearing Number	6316	
Ball Diameter (mm)	28.58	
Peak Current (A)	5.07	
Current Density (A/mm ²)	0.1	Pass*
Maximum Allowable Current (A)	13.46	



EDM BEARING CALCULATOR

SERIOUS SERVICE[®]
 Professional Machinery Health Care
 (Fan Doctor[®])

Bearing Number	6314	
Ball Diameter (mm)	25.40	
Peak Current (A)	5.07	
Current Density (A/mm ²)	0.1	Pass*
Maximum Allowable Current (A)	11.96	

Test Results

Pump #2 Before CoolBlue®



EDM BEARING CALCULATOR

SERIOUS SERVICE®
 Professional Machinery Health Care
 (Fan Doctor®)

Bearing Number	6316	
Ball Diameter (mm)	28.58	
Peak Current (A)	19.62	
Current Density (A/mm ²)	0.2	Fail*
Maximum Allowable Current (A)	13.46	



EDM BEARING CALCULATOR

SERIOUS SERVICE®
 Professional Machinery Health Care
 (Fan Doctor®)

Bearing Number	6314	
Ball Diameter (mm)	25.40	
Peak Current (A)	19.62	
Current Density (A/mm ²)	0.2	Fail*
Maximum Allowable Current (A)	11.96	

Pump #2 After CoolBlue®



EDM BEARING CALCULATOR

SERIOUS SERVICE®
 Professional Machinery Health Care
 (Fan Doctor®)

Bearing Number	6316	
Ball Diameter (mm)	28.58	
Peak Current (A)	5.34	
Current Density (A/mm ²)	0.1	Pass*
Maximum Allowable Current (A)	13.46	



EDM BEARING CALCULATOR

SERIOUS SERVICE®
 Professional Machinery Health Care
 (Fan Doctor®)

Bearing Number	6314	
Ball Diameter (mm)	25.40	
Peak Current (A)	5.34	
Current Density (A/mm ²)	0.1	Pass*
Maximum Allowable Current (A)	11.96	

Test Results

Pump #3 Before CoolBlue®



EDM BEARING CALCULATOR

SERIOUS SERVICE®
 Professional Machinery Health Care
 (Fan Doctor®)

Bearing Number	6313	
Ball Diameter (mm)	23.80	
Peak Current (A)	12.57	
Current Density (A/mm ²)	0.2	Fail*
Maximum Allowable Current (A)	11.21	

Pump #3 After CoolBlue®



EDM BEARING CALCULATOR

SERIOUS SERVICE®
 Professional Machinery Health Care
 (Fan Doctor®)

Bearing Number	6313	
Ball Diameter (mm)	23.80	
Peak Current (A)	5.20	
Current Density (A/mm ²)	0.1	Pass*
Maximum Allowable Current (A)	11.21	

Pump #4 Before CoolBlue®



EDM BEARING CALCULATOR

SERIOUS SERVICE®
 Professional Machinery Health Care
 (Fan Doctor®)

Bearing Number	6314	
Ball Diameter (mm)	25.40	
Peak Current (A)	12.53	
Current Density (A/mm ²)	0.2	Fail*
Maximum Allowable Current (A)	11.96	

Pump #4 After CoolBlue®



EDM BEARING CALCULATOR

SERIOUS SERVICE®
 Professional Machinery Health Care
 (Fan Doctor®)

Bearing Number	6314	
Ball Diameter (mm)	25.40	
Peak Current (A)	4.59	
Current Density (A/mm ²)	0.1	Pass*
Maximum Allowable Current (A)	11.96	

Summary

- Common mode peak currents measured since the installation of CoolBlue® Inductive Absorbers and NALA differential line absorbers are well below the recommended levels
- Peak Current reductions are as follows
 - Pump #1 – 72%
 - Pump #2 – 73%
 - Pump #3 – 59%
 - Pump #4 – 63%
- As well as the amplitude of the current being reduced, the frequency observed has slowed down significantly, and subsequent ringing in the lines after the peak spikes has almost been eliminated

End of Report



SERIOUS SERVICE®
Professional Machinery Health Care
(Fan Doctor®)



VIBES Corp®



Vibration **I**ndustrial **B**alancing & **E**quipment **S**ervices, Corporation

720 - 999 W. Broadway, Vancouver, BC V5Z 1K5

www.vibescorp.ca email: info@vibescorp.ca

Phone: 604 - 619 - 9381 (24/7)



Vendor Compliant for Property Owners, Management Firms of Commercial Buildings, Hospitals, Industrial Sites, & Infra-Structure Facilities